

Improving of Agricultural Products Preservation by Optimization of Ventilation Systems Operation Modes

Kucherenko Maria Nikolaevna

*Candidate of Technical Sciences, Assistant Professor,
Head of the Department «Heat and gas supply, ventilation, water supply and sewerage»
Togliatti State University, 14, Belorusskaya Street, Togliatti, 445020, Russian Federation.*

Sizenko Olga Aleksandrovna

*Candidate of Technical Sciences, Assistant Professor,
Department «Heat and gas supply, ventilation, water supply and sewerage» Togliatti State University,
14, Belorusskaya Street, Togliatti, 445020, Russian Federation.*

Bikunova Marina Victorovna

*Candidate of Technical Sciences, Assistant Professor, Department «Water Supply,
Sewerage and Hydraulic Engineering» Penza State University of Architecture and Construction,
28, German Titov Street, Penza, 440028, Russian Federation.*

Abstract

A thermodynamic approach to the calculation of ventilation systems operating time in storage facilities of juicy vegetable raw materials basing on the humidity potential theory is suggested. Results of theoretical and experimental studies of the dynamics of heat and mass transfer processes in a layer of stored products are shown. Improving of agricultural products preservation is achieved by optimization of ventilation systems operation modes.

Keywords: ventilating system, humidity potential, microclimate, juicy vegetable raw materials


INTRODUCTION

Juicy vegetable raw materials, as an object of storage, is characterized as biological heat and moisture generating substances. Changes in temperature and relative humidity within a layer causes significant deviation from the recommended microclimate norms, causing product wilting or sweating. Therefore, design and operation of microclimate control systems in the agricultural products storage facilities should take into account the dynamics of the processes of heat and mass transfer in a product layer. Investigation of the heat-and-moisture exchange laws should be based on the most general thermodynamic approach allowing to abandon wasting time on analyzing of particular patterns.

Plant raw material is the capillary-porous colloidal material. Liquid moisture and vapor movement in materials is caused by action of diffusion-osmotic and capillary forces.

Presence of free moisture in the plant material determines its physiological activity (life-sustaining activity). Out of all the biochemical processes, occurring in grass and grain,

respiration is of particular important - oxidation of organic substances. The reaction undergo in accordance with the known equation:



Theoretical amount of heat generated in an oxidation process is approximately 2870 kJ on 1 gMole. The actual amount of the generated heat, that is intensity of respiration, depends on the humidity and temperature of the raw material.

MATERIALS AND METHODS

The most complete calculation of the intensity of the interrelated heat and mass transfer is based on the theory of moisture content (humidity) potential, allowing to take into account the effect of various force factors on moisture, both in liquid and in vapor state [1].

The specific moisture flow i , kg/(m²·h), in the material is proportional to the gradient of moisture content potential

$$i = \chi \nabla \theta, \quad (1)$$

where χ – is the moisture conductivity, kg/(m·h·°B);

$\nabla \theta$ – humidity potential gradient, °B/m.

By analogy with other physical phenomena, the flow of moisture from the surface of the wet material is proportional to the humidity potential gradient:

$$j_{\theta} = \alpha_{\theta} (\theta_{\text{surf}} - \theta_a), \quad (2)$$

where θ_{surf} – humidity potential of the material surface, °B;

θ_a – humidity potential of the purge air, °B;

α_θ – coefficient of the moisture transfer, kg/(kg·h·°B)

Value of air humidity potential can be determined analytically from the proposed dependences [2]:

$$p_v = a_{t1} \cdot (1 - e^{-b_{t1} \cdot \theta}), \text{ at } 0 \leq t \leq 5^\circ\text{C and } 65\% < \varphi \leq 100\% ; \quad (3)$$

$$p_v = a_{t2} + b_{t2} \cdot r_t^\theta, \text{ at } t > 5^\circ\text{C and } 65\% < \varphi \leq 100\% ; \quad (4)$$

$$p_v = 0,023 + 0,017 \cdot \theta^{1,34}; \text{ at } p_v \leq 0,4 \text{ kPa and } \varphi < 65\% ; \quad (5)$$

$$p_v = 4,15 \cdot \ln(0,46 \cdot \ln(\theta)); \text{ at } p_v > 0,4 \text{ kPa and } \varphi < 65\% ; \quad (6)$$

where a_{t1} , b_{t1} , a_{t2} , b_{t2} , r_t – temperature coefficients;

p_v – vapor pressure, Pa;

φ – air relative humidity.

RESULTS AND DISCUSSION

To obtain a mathematical expression describing the coefficient values a_{t1} , b_{t1} , a_{t2} , b_{t2} , r_t , graphs of them were drawn up and are presented on Figure 1-5.

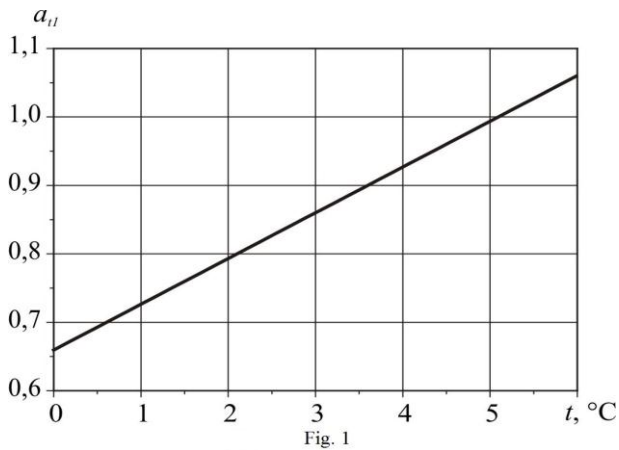


Figure 1. Dependence of coefficient a_{t1} on air temperature

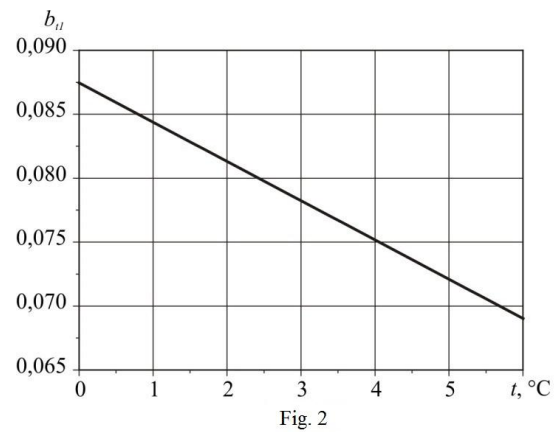


Figure 2. Dependence of coefficient b_{t1} on air temperature

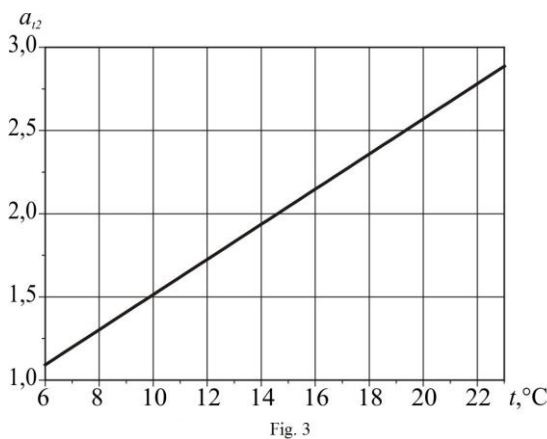


Figure 3. Dependence of coefficient a_{t2} on air temperature

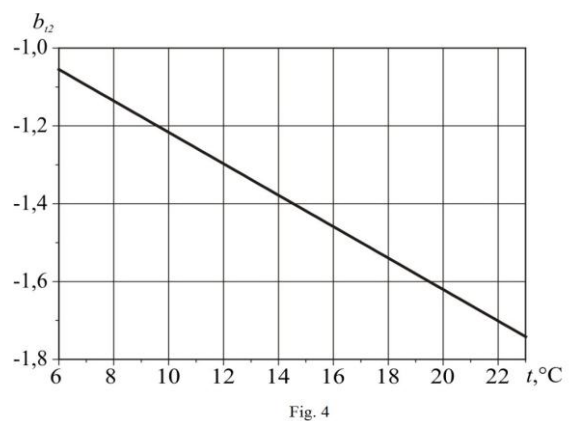


Figure 4. Dependence of coefficient b_{t2} on air temperature

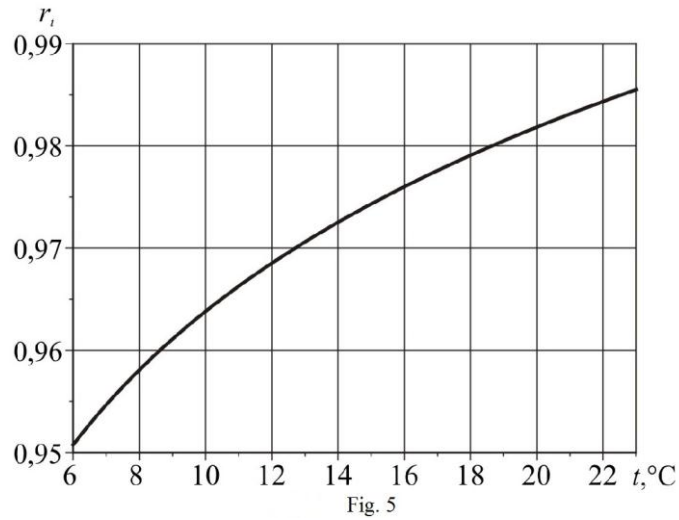


Figure 5. Dependence of coefficient r_t on air temperature

Approximation of the curves results:

$$a_{t1} = 0,66 + 0,067 \cdot t; \quad (7)$$

$$b_{t1} = 0,088 - 0,0033 \cdot t; \quad (8)$$

$$a_{t2} = 0,46 + 0,11 \cdot t; \quad (9)$$

$$b_{t2} = -0,81 - 0,04 \cdot t; \quad (10)$$

$$r_t = 0,91 \cdot t^{0,027}. \quad (11)$$

Basing of the received dependences, lines of constant potentials where drawn-up $\theta = \text{const}$ and plotted on the $I-d$ -diagram (Fig. 6).

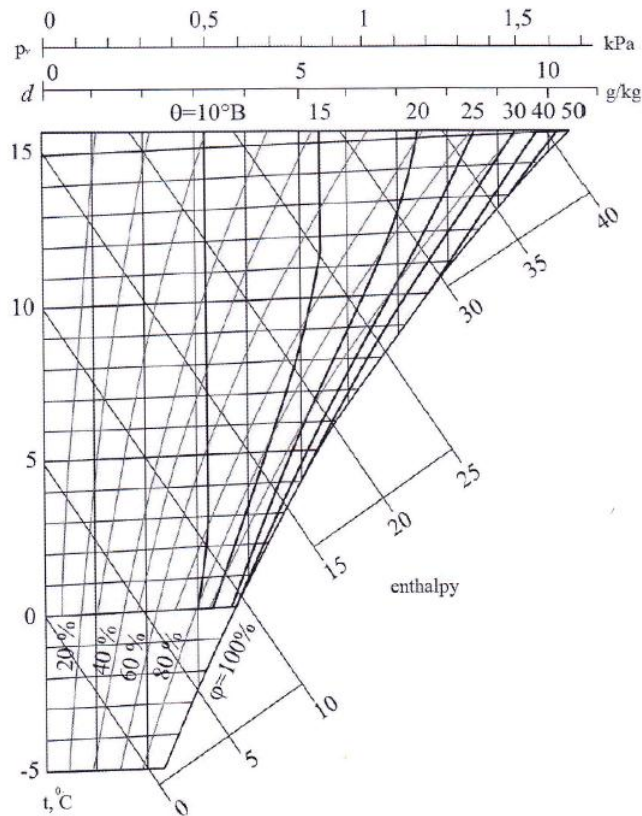


Figure 6. Refined $I-d-\theta$ - diagram at low positive temperatures

Transfer of visible and latent heat between the blown air and products takes place in the same direction – that is the main feature of heat and mass transfer in a bulk of juicy plant raw material.

The change of heat and humidity characteristics of the blown air (presented on $I-d-\theta$ - diagram) is shown in Figure 7. The air blown to the bulk, passes through an adjustment layer in which it is humidified to equilibrium values and, at the same time, is heated to the temperature of the bottom part of the main layer (process AB), at that the evaporating moisture helps to reduce the temperature of the products. The moisture content potential θ_A at the entrance to the raw material layer is determined by the air parameters blown-in into the storage area. Section BC characterizes the process of the blown air parameters changing in the main layer, which is equidistant to the corresponding section of the full saturation $\phi = 100\%$. Humidity potential on the stored plant matter surface depends on the moisture sweated due to breathing in the storage area. Air is removed from the bulk, with parameters corresponding to point C ($t_C, \phi_C, \theta_C, d_C$). When ventilation in the storage area is off, the temperature of the product in the upper layer may be lower than the temperature inside the main layer, causing air cooling and possible moisture condensation on the raw material surface (processes CD, CD_1).

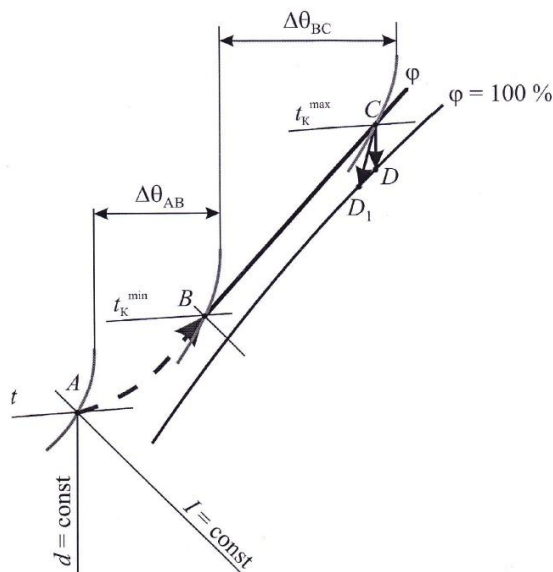


Figure 7. Changing of air parameters blown into the bulk of juicy vegetable raw materials. A,B,C – characteristic points, t – air temperature; t_k^{\min} and t_k^{\max} – minimum and maximum temperature in the layer

According to the theory of moisture content potential, moisture-flow W , g/h, from the bulk of juicy plant raw material mass (G_{mat}, t), to the purge air (the process AC Fig. 7) is equal to:

$$W = \alpha_\theta (\theta_C - \theta_A) G_{mat} \quad (12)$$

where θ_A, θ_C – initial and final humidity potential in the layer of products during storage, °B; α_θ – moisture ratio, g/(t·h·°B).

For assessment of humidity potential dynamic changes in a layer of the stored products, full-scale research was conducted in potato-storage house. 24 container with potatoes were selected in the middle of the storage house. Measurements of temperature and humidity were taken in distinctive zones of the selected containers and storage-house, at mid-height of the container. Measurements of temperature and humidity were taken in 36 points. Measurements were taken every fortnight, during the main months of storage (November – January). Based on the measurements results and the updated $I-d-\theta$ -diagram, the fields of humidity potentials were drawn-up for each day of the measurements (Figure 8).

The uniform character of the fields of humidity potentials, justify the application of the humidity potential concept and $I-d-\theta$ -diagram for runtime of ventilation systems. The humidity potential values θ within the storage house vary from 14,0 to 21,9 °B, depending on the geometrical arrangement of the containers. Uniform gradient of the humidity potential was observed height-wise of the stack [3].

Observed dynamics of the humidity potential fields change allow to consider the stack of juicy plant raw material as a bulk with evenly distributed sources of heat and moisture over the volume.

Based on the obtained humidity potential fields, graph of humidity potential variation height-wise was plotted (Fig. 9). As a result of approximation, dependence characterizing the humidity potential, °B, on the layer's height:

$$\theta = \frac{h + 9,37}{0,59}, \quad (13)$$

where h – product layer's height, m.

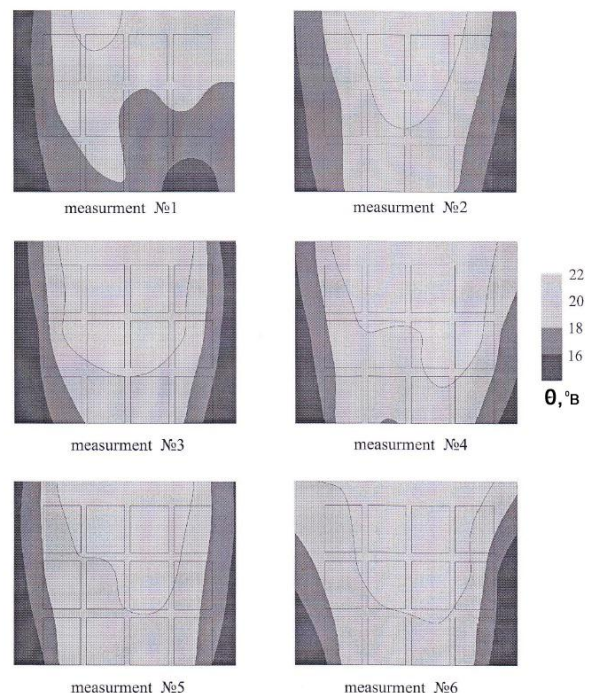


Figure 8. Humidity potential fields in the storage-house

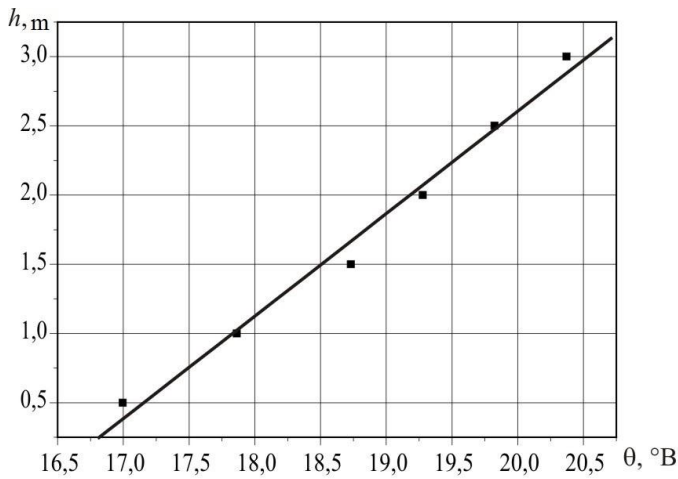


Figure 9. Humidity potential dynamic changes depending on a layer's height

Basing on the definition of the moisture flow from the standpoint of the theory of the humidity potential, mass transfer coefficient α_θ , $\text{g}/(\text{t}\cdot\text{h}\cdot^\circ\text{B})$, is calculated as:

$$\alpha_\theta = \frac{g_s (d_e - d_i)}{\theta_e - \theta_i}, \quad (14)$$

where θ_i – initial humidity potential of the air blown into the storage, $^\circ\text{B}$;

θ_e – humidity potential of the exhaust air, $^\circ\text{B}$;

g_s – specific airflow, $\text{kg}/(\text{h}\cdot\text{t})$;

d_i, d_e – the moisture content of the supply and exhaust air, g/kg .

Basing revised $I-d-\theta$ -diagram and obtained experimental data (See [4]), graphically presented dependence of mass transfer coefficient α_θ via temperature and specific air flow rate was obtained (Fig. 10).

For the analytical assessment of the mass transfer coefficient α_θ , with sufficient for engineering calculations accuracy, the following expression is proposed to use:

$$\text{at } 10 < g_s < 20: \quad \alpha_\theta = 0,25 \cdot \Delta t + 2,94; \quad (15)$$

$$\text{at } 20 < g_s < 30: \quad \alpha_\theta = 0,42 \cdot \Delta t + 4,9; \quad (16)$$

$$\text{at } 30 < g_s < 40: \quad \alpha_\theta = 0,59 \cdot \Delta t + 6,86, \quad (17)$$

where Δt – temperature difference of the exhaust and supply air, $^\circ\text{C}$.

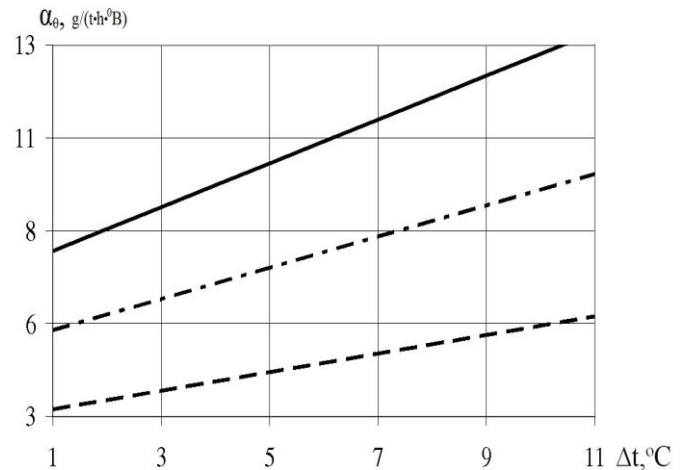


Figure 10. The values of the coefficient α_θ in a layer of juicy vegetable raw materials, depending on the specific consumption of purge air: --- – at $10 < g_s < 20$; - - - - at $20 < g_s < 30$; ——— – at $30 < g_s < 40$

At present, the existing engineering assessment of the microclimate of juicy vegetable raw materials storage in bulk is limited only to temperature regime assessment [5].

To achieve maximum product preservation, ensuring the required microclimate parameters the system should operate during a day:

$$K_{t,vent}^\theta = \frac{W}{\alpha_\theta (\theta_e - \theta_i) G_{mat}}, \quad (18)$$

where $K_{t,vent}^\theta$ – is the coefficient characterizing the time of ventilation system running during the day, depending on the humidity of a bulk; W – specific moisture generating by products, g/h .

CONCLUSION

1. Description of the heat and mass transfer processes from the standpoint of the theory of the humidity potential, allows to evaluate the thermodynamic performance of the systems qualitatively and quantitatively, assuring the appropriate storage microclimate of biologically active products.
2. Engineering method developed for calculating the operating time of ventilation systems based on the use of the $I-d-\theta$ -diagram allows to improve the quality of the design and operation of the systems providing the required parameters of the microclimate during storing.
3. Optimization of a ventilation system operation modes in storage of agricultural products taking into account the dynamics of the heat and mass transfer processes in a product's layer allows to reduce energy consumption and increase the products preservation.

REFERENCES

- [1] Bogoslovsky, V.N. 1982. Building Thermophysics. Moscow, Higher school, Pages 415
- [2] Kucherenko, M.N., Kuznetsov, E.P. 2012. Graphic-analytical study I-d- θ diagram of moist air at low temperatures. Privolzhsky scientific journal, 2: 73-77.
- [3] Kucherenko, M.N., Kuznetsov, E.P., Greysoukh, G. I., Stepanov, S. A., Ezhov, E. G. 2016. Ventilation system design for agricultural storage facilities taking into account the dynamics of heat and mass transfer in a product layer / Regional architecture and engineering, 3(28): 149-154.
- [4] Kalashnikov, M.P. 1999. Ensuring parameters of microclimate for storage of potatoes and vegetables under extreme continental climate conditions. Ulan Ude, VSGTU, Pages 235.
- [5] Bodrov, V.I. 2008. Microclimate of industrial agricultural buildings and structures. N. Novgorod, NNGASU, Pages 623.